

















# Lindab **Dampers**

Mounting instructions

# Product overview

## Standard dampers



	To regulate	To shut-off
manual	 DRU  EKOSI	 DSU  DTU  DTMU
for motor	electric or pneumatic  DRH1U	 DTH1U  DTH2U  DTHU
	electric  DTBVU DRBVU	 DSUSN  DTBU  DTBCU  DTFU  DTBLU
with motor    pneumatic		 DTPU

## Cleaning dampers



	To regulate	To shut-off
manual	 PSDRU  TDRU	

# Product overview

## Alternating dampers

	To regulate	To shut-off
manual		 <p>TASU      TATU</p>
with motor    electric		 <p>TATBU</p>

## Constant- and variable airflow units (automatic dampers)

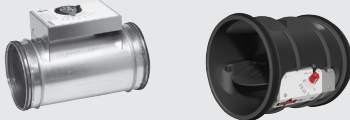	To regulate	To shut-off
manual	 <p>DAU      VRL1</p>	
with motor    electric	 <p>DAVU DA2EU</p>	

## Air stream operated damper

	To regulate	To shut-off
manual	 <p>RSKA</p>	

# Product overview

## Airflow meters



## Airflow meters with UltraLink

### UltraLink



### UltraLink with damper




## Other dampers


### Rectangular damper



### Regulating dampers



### Sliding dampers

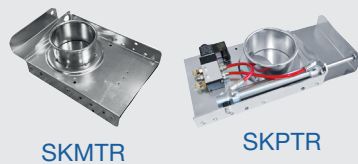

### Air stream operating dampers



## Accessories

### Insulation cup



### Handles



### Assembly kits



### Extension spindles



### Mounting shelves



# Dampers

**DRBVU, DRH1U, DRU, DSU, DTU, DTHU, DTH1U, DTH2U, DTBU, DTBVU, DTBCU, DTFU, DTBLU, DSUSN, DTPU, PSDRU, TDRU, TASU, TATU, TATBU**

## Assembly


In order to fulfil the requirements for air-tightness class D, the dampers must be installed as per 'Assembly Instruction Lindab Safe'.

For certain manual dampers, there is the option of adding a motor later on.

The dampers allow 50 mm duct insulation without the knob being hidden. For 100 mm duct insulation, there is an insulation cup, IK, for DRU, DSU, DTU, TASU and TATU.

## PSDRU and TDRU

The dampers are installed by inserting the two guide pins on the T-piece or saddle into the L-shaped slots on the dampers. The dampers are then locked by turning them slightly clockwise.

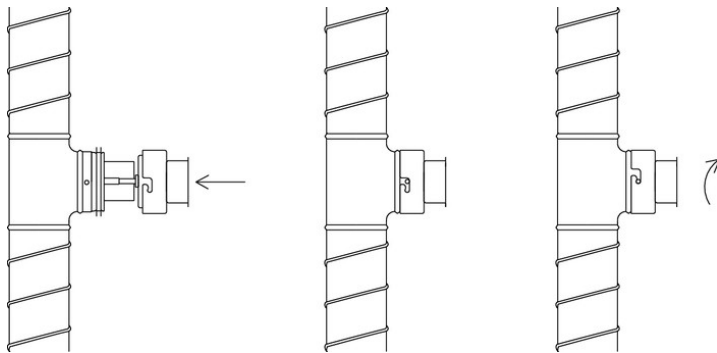

## Balancing

On DRU, PSDRU and TDRU the damper blade is stepless adjustable through 0–90° (0°=fully open, 90°=completely closed) using the knob in the cup. Locking is performed using screws for Pozidrive (PZD2) and the damper angle can be read off a stamped grade on the edge of the cup. Other types of damper normally only work in the fully open or completely closed positions.

On motorized shut-off dampers and dampers adapted for a motor, the shaft end for the motor is equipped with a notch showing the position of the damper blade.

Manual dampers  $\varnothing < 355$  can be supplemented with a sturdy handle to facilitate adjustment. Larger dimensions are equipped with a handle as standard.

## Maintenance

Dampers and motors normally don't require any maintenance.

## CE marking


Our dampers with electrical actuator are regarded as a component in the duct system and does not need to be CE marked separately.

Their electrical actuators on the other hand are part of the electrical system and are CE marked. Declaration of compliance with the essential requirements can be found at [www.belimo.ch](http://www.belimo.ch).


# Dampers

	<b>CM 24 / CM 24 F</b>
Power supply.....	AC 19,2–28,8 V, 50/60 Hz DC 19,2–28,8 V
Power consumption .....	0,5 W
For wire sizing .....	1 VA
Connection .....	Cable 1 m, 3x0,75 mm <sup>2</sup>
Operating angle.....	Continuously rotating
Torque at rated voltage.....	Min. 2 Nm
Direction of rotation.....	-L or -R
Position indication.....	Mechanical, removable
Running time for 95° .....	75 s
Sound power level.....	Max. 35 dB (A)
Protection class.....	III Safety extra-low voltage
Protection type .....	IP 54
Ambient temperature range .....	-30 to +50°C
Ambient moisture .....	95 % RF

	<b>CM 230 / CM 230 F</b>
Power supply.....	AC 65–265 V, 50/60 Hz
Power consumption .....	1,5 W
For wire sizing .....	3 VA
Connection .....	Cable 1 m, 3x0,75 mm <sup>2</sup>
Operating angle.....	Max. 95°, adjustable 0–100%
Torque at rated voltage.....	Min. 2 Nm
Direction of rotation.....	-L or -R
Position indication.....	Mechanical, removable
Running time for 95° .....	75 s
Sound power level.....	Max. 35 dB (A)
Protection class.....	II Safety insulated
Protection type .....	IP 54
Ambient temperature range .....	-30 to +50°C
Ambient moisture .....	95 % RF

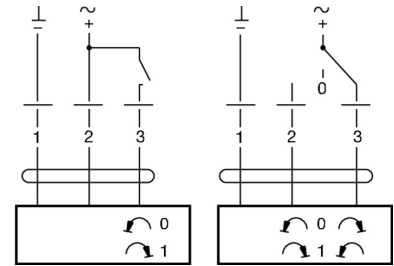


	<b>CM 24 SR</b>
Power supply.....	AC 24 V, 50/60 Hz DC 24 V
Power consumption .....	0,5 W
For wire sizing .....	2 VA
Connection .....	Cable 1 m, 4x0,75 mm <sup>2</sup>
Torque at rated voltage.....	Min. 2 Nm
Direction of rotation.....	Switch selectable 0 or 1
Running time for 95° .....	75 s
Sound power level.....	Max. 35 dB (A)
Protection class.....	III Safety extra-low voltage
Protection type .....	IP 54
Ambient temperature range .....	-30 to +50°C
Ambient moisture .....	95 % RH

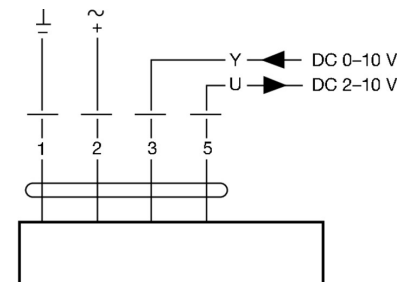


	<b>LM 24 A-F</b>
Power supply.....	AC 19,2–28,8 V, 50/60 Hz DC 19,2–28,8 V
Power consumption .....	1 W
For wire sizing .....	2 VA
Connection .....	Cable 1 m, 3x0,75 mm <sup>2</sup>
Operating angle.....	Max. 95°, adjustable 0–100%
Torque at rated voltage.....	Min. 5 Nm
Direction of rotation.....	Switch selectable 0 or 1
Position indication.....	Mechanical
Running time for 95° .....	150 s
Sound power level.....	Max. 35 dB (A)
Protection class.....	III Safety extra-low voltage
Protection type .....	IP 54
Ambient temperature range .....	-30 to +50°C
Ambient moisture .....	95 % RH

	<b>LM 230 A-F</b>
Power supply.....	AC 65–265 V, 50/60 Hz
Power consumption .....	1,5 W
For wire sizing .....	4 VA
Connection .....	Cable 1 m, 3x0,75 mm <sup>2</sup>
Operating angle.....	Max. 95°, adjustable 0–100%
Torque at rated voltage.....	Min. 5 Nm
Direction of rotation.....	Switch selectable 0 or 1
Position indication.....	Mechanical
Running time for 95° .....	150 s
Sound power level.....	Max. 35 dB (A)
Protection class.....	II Safety insulated
Protection type .....	IP 54
Ambient temperature range .....	-30 to +50°C
Ambient moisture .....	95 % RH

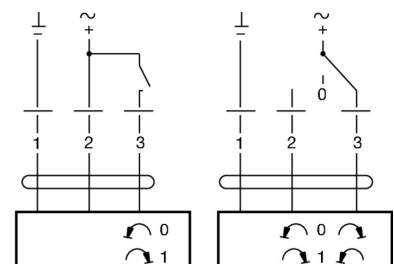


# Dampers


	<b>LMQ 24A</b>	<b>LMQ-SR 24A</b>
Power supply.....	AC 19,2-28,8 V, 50/60 Hz	AC 19,2-28,8 V, 50/60 Hz
.....	DC 21,6-28,8 V	DC 21,6-28,8 V
Power consumption .....	13 W	12 W
For wire sizing .....	23 VA	23 VA
Connection .....	Cable 1 m, 3x0,75 mm <sup>2</sup>	Cable 1 m, 4x0,75 mm <sup>2</sup>
Operating angle.....	Max. 95°, adjustable 0-100 %	Max. 95°, adjustable 0-100 %
Torque at rated voltage.....	Min. 4 Nm	Min. 4 Nm
Direction of rotation.....	Switch selectable 0 ↻ or 1 ↻	Switch selectable 0 ↻ or 1 ↻
Position indication.....	Mechanical	Mechanical
Running time for 90° .....	2,5 s	2,5 s
Sound power level.....	52 dB (A)	52 dB (A)
Protection class.....	III Safety extra-low voltage	II Safety insulated
Protection type .....	IP 54	IP 54
Ambient temperature range .....	-30 to +40°C	-30 to +40°C
Ambient moisture .....	95 % RH	95 % RH

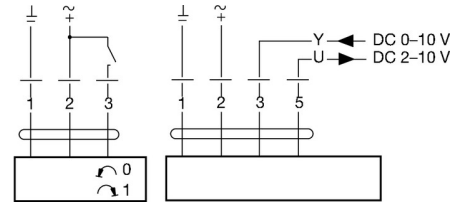

	<b>LM 24 A-SR</b>	<b>LM 230 A-SR</b>
Power supply.....	AC 19,2-28,8 V, 50/60 Hz	AC 230 V, 50/60 Hz
.....	DC 19,2-28,8 V	
Power consumption .....	1 W	1,8 W
For wire sizing .....	2 VA	4 VA
Connection .....	Cable 1 m, 4x0,75 mm <sup>2</sup>	Cable 1 m, 2x0,75 mm <sup>2</sup>
Operating angle.....	Max. 95°, adjustable	Max. 95°, adjustable
Torque at rated voltage.....	Min. 5 Nm	Min. 5 Nm
Direction of rotation.....	Switch selectable 0 ↻ or 1 ↻	Switch selectable 0 ↻ or 1 ↻
Position indication.....	Mechanical	Mechanical
Running time for 95° .....	150 s	150 s
Sound power level.....	35 dB (A)	35 dB (A)
Protection class.....	III Safety extra-low voltage	II
Protection type .....	IP 54	IP 54
Ambient temperature range .....	-30 to +50°C	-30 to +50°C
Ambient moisture .....	95 % RH	95 % RH

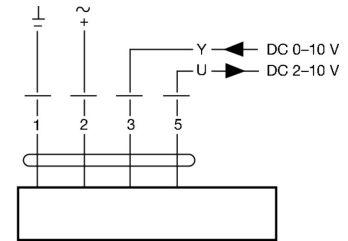


	<b>LM 24 A-SX</b>
Power supply.....	AC 19,2-28,8 V, 50/60 Hz
DC 21,6-28,8 V .....	
Power consumption .....	2 W
For wire sizing .....	4 VA
Connection .....	Cable 1 m, 4x0,75 mm <sup>2</sup>
Operating angle.....	Max. 95°, adjustable 0-100 %
Torque at nominal voltage .....	Min. 5 Nm
Direction of rotation.....	Switch selectable 0/1
Position at Y=0 V.....	Switch selectable 0 ↻ or 1 ↻
Position indication.....	Mechanical
Running time for 90° .....	150 s
Sound power level.....	35 dB (A)
Protection class.....	III Safety extra-low voltage
Protection type .....	IP 54
Ambient temperature range .....	-30 to +50 °C
Ambient humidity .....	95 % RH

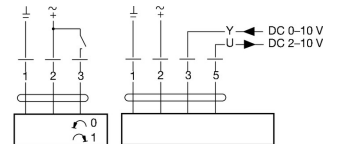


# Dampers


	<p><b>NM 24 A-F</b>                  AC 19,2–28,8 V, 50/60 Hz                  DC 19,2–28,8 V</p>	<p><b>NM 230 A-F</b>                  AC 85–265 V, 50/60 Hz</p>
Power supply.....	1,5 W	2,5 W
Power consumption .....	3,5 VA	6 VA
For wire sizing .....	Cable 1 m, 3x0,75 mm <sup>2</sup>	Cable 1 m, 3x0,75 mm <sup>2</sup>
Connection.....	Max. 95°, adjustable 0–100%	Max. 95°, adjustable 0–100 %
Operating angle.....	Min. 10 Nm	Min. 10 Nm
Torque at rated voltage.....	Switch selectable	Switch selectable
Direction of rotation.....	0 ↺ or 1 ↻	0 ↺ or 1 ↻
Position indication.....	Mechanical	Mechanical
Running time for 95° .....	150 s	150 s
Sound power level.....	Max. 35 dB (A)	Max. 35 dB (A)
Protection class.....	III Safety extra-low voltage	II Safety insulated
Protection type .....	IP 54	IP 54
Ambient temperature range .....	-30 to +50°C	-30 to +50°C
Ambient moisture .....	95 % RH	95 % RH

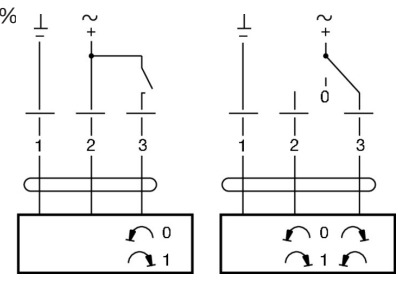

	<p><b>SM 24 A</b>                  AC 19,2–28,8 V, 50/60 Hz                  DC 19,2–28,8 V</p>	<p><b>SM 230 A</b>                  AC 85–265 V, 50/60 Hz</p>
Power supply.....	2 W	2,5 W
Power consumption .....	4 VA	6 VA
For wire sizing .....	Cable 1 m, 3x0,75 mm <sup>2</sup>	Cable 1 m, 3x0,75 mm <sup>2</sup>
Connection.....	Max. 95°, adjustable 0–100%	Max. 95°, adjustable 0–100%
Operating angle.....	Min. 20 Nm	Min. 20 Nm
Torque at rated voltage.....	Switch selectable	Switch selectable
Direction of rotation.....	0 ↺ or 1 ↻	0 ↺ or 1 ↻
Position indication.....	Mechanical	Mechanical
Running time for 95° .....	150 s	150 s
Sound power level.....	Max. 35 dB (A)	Max. 35 dB (A)
Protection class.....	III Safety extra-low voltage	II Safety insulated
Protection type .....	IP 54	IP 54
Ambient temperature range .....	-30 to +50°C	-30 to +50°C
Ambient moisture .....	95 % RH	95 % RH

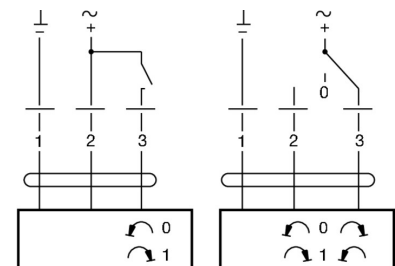


	<p><b>GM 24 A</b>                  AC 19,2–28,8 V, 50/60 Hz                  DC 19,2–28,8 V</p>	<p><b>GM 230 A</b>                  AC 85–265 V, 50/60 Hz</p>
Power supply.....	4,5 W	4,5 W
Power consumption .....	7 VA	7 VA
For wire sizing .....	Cable 1 m, 3x0,75 mm <sup>2</sup>	Cable 1 m, 3x0,75 mm <sup>2</sup>
Connection.....	Max. 95°, adjustable 0–100%	Max. 95°, adjustable 0–100%
Operating angle.....	Min. 40 Nm	Min. 40 Nm
Torque at rated voltage.....	Switch selectable	Switch selectable
Direction of rotation.....	0 ↺ or 1 ↻	0 ↺ or 1 ↻
Position indication.....	Mechanical	Mechanical
Running time for 95° .....	150 s	150 s
Sound power level.....	Max. 45 dB (A)	Max. 45 dB (A)
Protection class.....	III Safety extra-low voltage	II Safety insulated
Protection type .....	IP 54	IP 54
Ambient temperature range .....	-30 to +50°C	-30 to +50°C
Ambient moisture .....	95 % RH	95 % RH

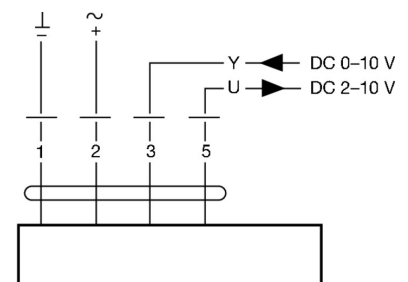


# Dampers

	<b>TF 24</b>	<b>TF 230</b>
Power supply.....	2AC 19,2–28,8 V, 50/60 Hz DC 21,6–28,8 V	AC 85–265 V, 50/60 Hz
Power consumption		
– during opening.....	2,5 W	2,5 W
– stand-by .....	1,5 W	1,5 W
For wire sizing .....	5 VA	5 VA
Connection .....	Cable 1 m, 2×0,75 mm <sup>2</sup>	Cable 1 m, 2×0,75 mm <sup>2</sup>
Operating angle, adjustable .....	Mech. limited to 95°	Mech. limited to 95°
Torque at rated voltage		
– motor .....	Min. 2 Nm	Min. 2 Nm
– return spring .....	Min. 2 Nm	Min. 2 Nm
Direction of rotation.....	Optional through right or	Optional through right or
left-hand installation L/R .....		left-hand installation L/R
Position indication .....	Mechanical	Mechanical
Running time		
– motor .....	< 75 s (0–2 Nm)	< 75 s (0–2 Nm)
– return spring .....	< 25 s	< 25 s
Degree of protection.....	IP 42	IP 42
Ambient temperature range .....	-30 to +50°C	-30 to +50°C




	<b>LF 24</b>	<b>LF 230</b>
Power supply.....	2AC 19,2–28,8 V, 50/60 Hz DC 21,6–28,8 V	AC 198–264 V, 50/60 Hz
Power consumption		
– during opening.....	5 W	5 W
– stand-by .....	2,5 W	3 W
For wire sizing .....	7 VA	7 VA
Connection .....	Cable 1 m, 2×0,75 mm <sup>2</sup>	Cable 1 m, 2×0,75 mm <sup>2</sup>
Operating angle, adjustable .....	Mech. limited to 95°	Mech. limited to 95°
Torque at rated voltage		
– motor .....	Min. 4 Nm	Min. 4 Nm
– return spring .....	Min. 4 Nm	Min. 4 Nm
Direction of rotation.....	Optional through right or	Optional through right or
left-hand installation L/R .....		left-hand installation L/R
Position indication .....	Mechanical	Mechanical
Running time		
– motor .....	40–75 s (0–4 Nm)	40–75 s (0–4 Nm)
– return spring .....	app. 20 s	app. 20 s
Sound power level		
– motor .....	max 50 dB (A)	max 50 dB (A)
– return spring .....	app. 62 dB (A)	app. 62 dB (A)
Degree of protection.....	IP 54	IP 54
Ambient temperature range .....	-30 to +50°C	-30 to +50°C




# Dampers

	<b>SFA (both 24 V and 230 V power supply)</b>	
Power supply.....	AC 19,2–28,8 V, 50/60 Hz DC 21,6–137,5 V	
Power consumption	7 W	
– during operation .....	3,5 W	
– stand-by .....	18 VA ( $I_{max}$ 20 A @ 5 ms)	
For wire sizing .....	Cable 1 m, 2x0,75 mm <sup>2</sup>	
Connection .....	Mech. limited to 95°	
Operating angle, adjustable .....	Mech. limited to 95°	
Torque at rated voltage	Min. 20 Nm	
– motor .....	Min. 20 Nm	
– spring bias .....	Optional through right or left-hand installation L/R	
Direction of rotation .....	Mechanical	
Position indication .....	Mechanical	
Running time	≤ 75 s (0 ... 20 Nm)	
– motor .....	≤ 20 s @ -20 ... 50°C / max. 60 s @ -30°C	
– return spring .....		
Sound power level	≤ 45 dB (A)	
– motor .....	≤ 62 dB (A)	
– return spring .....		
Degree of protection.....	IP 54	
Ambient temperature range .....	-30 to +50 °C	
Ambient temperature range .....	-30 to +50 °C	

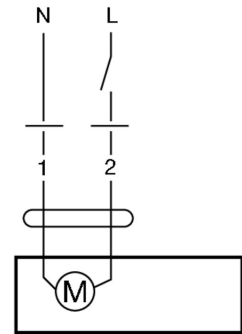

	<b>EF 24A</b>	<b>EF 230A</b>
Power supply.....	AC 19,2–28,8 V, 50/60 Hz DC 21,6–28,8 V	AC 90–264 V, 50/60 Hz
Power consumption	9,5 W	9 W
– during operation .....	4,5 W	4,5 W
– stand-by .....	16 VA	21 VA
For wire sizing .....	Cable 1 m, 2x0,75 mm <sup>2</sup>	Cable 1 m, 2x0,75 mm <sup>2</sup>
Connection .....	Mech. limited to 95°	Mech. limited to 95°
Operating angle, adjustable .....	Mech. limited to 95°	Mech. limited to 95°
Torque at rated voltage	Min. 30 Nm	Min. 30 Nm
– motor .....	Min. 30 Nm	Min. 30 Nm
– spring bias .....	Optional through right or left-hand installation L/R	Optional through right or left-hand installation L/R
Direction of rotation .....	Mechanical	Mechanical
Position indication .....	Mechanical	Mechanical
Running time	≤ 75 s (0–30 Nm)	≤ 75 s (0–30 Nm)
– motor .....	≤ 20 s	≤ 20 s
– return spring .....		
Sound power level	≤ 55 dB (A)	≤ 55 dB (A)
– motor .....	≤ 71dB (A)	≤ 71dB (A)
– return spring .....		
Degree of protection.....	IP 54	IP 54
Ambient temperature range .....	-30 to +50 °C	-30 to +50 °C

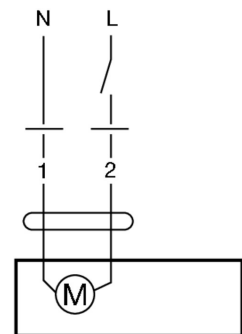

# Dampers

## LKSR

### Assembly

In order to fulfil the requirements for air-tightness ATC3 (C), the damper must be installed as per 'Assembly Instruction Rectangular air duct systems'.

For the damper, there is the option of adding a motor later on.

The damper allows a 50 mm duct insulation without the knob being hidden. For 100 mm insulation, an insulation cup, IK, is available.

### Balancing

On LKSR the damper blade is adjusted through 0–90° (0° = fully open, 90° = completely closed) using the knob in the cup. Locking is performed using screws for Pozidrive (PZD2) and the damper angle can be read off a stamped grade on the edge of the cup.

Manual damper can be supplemented with a sturdy handle to facilitate adjustment.

### Maintenance

The damper and motor normally don't require any maintenance.

# Constant/variable air airflow dampers

## DAU, DA2EU, DAVU

### Assembly

In order to fulfil the requirements for air-tightness class D, the devices must be installed as per 'Assembly Instruction Lindab Safe'.

The devices must be installed with the air air airflow in the direction of the arrow.

The devices allow 50 mm duct insulation without the scale or any motor being hidden.

### Pressure range

50–1000 Pa over the unit.

### Interference sensitivity

In order to achieve stated precision for the set air airflow, a straight duct of at least  $3 \times d$  before and  $1.5 \times d$  after the devices is required. A assembly close to a source of interference (bend, saddle, etc.) reduces control accuracy and the air airflow can deviate from the set value.

### Changes in direction

The units are independent of their direction of installation; you can deviate from the projected direction and install them in any direction you like without affecting accuracy.

### Systematic error

#### Control accuracy

The devices are calibrated within their entire operating range at the factory. This means the devices keep the air airflow constant to within approx.  $\pm 5$  to  $\pm 10$  % of the set air airflow. Larger deviations occur at lower air airflows, especially with small sizes.

### Maintenance

The devices normally don't require any maintenance, but should be protected from contaminated air wherever possible.

### CE marking

Our dampers with electrical actuator are regarded as a component in the duct system and does not need to be CE marked separately.


Their electrical actuators on the other hand are part of the electrical system and are CE marked. Declaration of compli-

# Constant/variable airflow dampers

ance with the essential requirements can be found at [www.belimo.ch](http://www.belimo.ch).

## DAU

The air airflow is adjusted by loosening the central nut and using the knob to turn the scale arrow so that it points to the desired air airflow on the scale. The nut is then locked.




## DA2EU

### Setting of air airflows

The two air airflows are set by moving the end stops. At delivery the stops are set at largest possible distance. If you want to limit the air airflow span proceed in the following way:

1. The one air airflow is set by turning the spindle so that the scale arrow points at the desired airflow and thereafter move one of the end stops close up to the clamp's one heel and lock the stop there.
2. The other airflow is set by turning the spindle so that the scale arrow points at this airflow and thereafter move the other end stop close up to the clamp's other heel and lock this stop there.




### Choice of airflows

The one airflow is chosen by feeding an operating voltage. This voltage, 24 or 230 V, turns the motor to one of the stops.

The other airflow is chosen by breaking the operating voltage. The motor then goes to the other stop.

## Technical data for the motors

	<b>LM 24 A</b>	<b>LM 230 A</b>
Power supply.....	AC 19,2–28,8 V, 50/60 Hz DC 19,2–28,8 V	AC 65–265 V, 50/60 Hz
Power consumption .....	1 W	1,5 W
For wire sizing .....	2 VA	4 VA
Connection.....	Cable 1 m, 3×0,75 mm <sup>2</sup>	Cable 1 m, 3×0,75 mm <sup>2</sup>
Operating angle.....	Max. 95°, adjustable 0–100%	Max. 95°, adjustable 0–100%
Torque at rated voltage.....	Min. 5 Nm	Min. 5 Nm
Direction of rotation.....	Switch selectable 0 ↻ or 1 ↻	Switch selectable 0 ↻ or 1 ↻
Position indication.....	Mechanical	Mechanical
Running time for 95° .....	150 s	150 s
Sound power level.....	Max. 35 dB (A)	Max. 35 dB (A)
Protection class.....	III Safety extra-low voltage	II Safety insulated
Protection type.....	IP 54	IP 54
Ambient temperature range .....	-30 to +50°C	-30 to +50°C
Ambient moisture .....	95 % RH	95 % RH

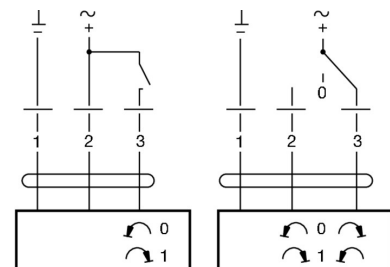


# Constant/variable airflow dampers

## DAVU

### Setting of airflow limits

The two airflow limits are set by moving the end stops. At delivery the stops are set at largest possible distance. If you want to limit the airflow span proceed in the following way:

1. The one airflow limit is set by turning the spindle so that the scale arrow points at the desired airflow and thereafter move one of the end stops close up to the clamp's one heel and lock the stop there.
2. The other airflow limit is set by turning the spindle so that the scale arrow points at this airflow and thereafter move the other end stop close up to the clamp's other heel and lock this stop there.
3. The motor shall then be adapted so that the regulating span 2–10 V adapts to the thus set airflow span. This is done by a push on the "gear disengagement" button. The motor then automatically performs a stroke between the airflow limits.




### Choice of airflow

The airflow is chosen by feeding a control signal. This signal, 2–10 V, sets the motor in a proportional position between the airflow limits.

### Technical data for the motor

	<b>LM 24 A-SX</b>
Power supply.....	AC 19,2–28,8 V, 50/60 Hz DC 21,6–28,8 V
Power consumption .....	2 W
For wire sizing .....	4 VA
Connection .....	Cable 1 m, 4×0,75 mm <sup>2</sup>
Operating angle.....	Max. 95°, adjustable 0–100 %
Torque at nominal voltage .....	Min. 5 Nm
Direction of rotation.....	Switch selectable 0/1
Position at Y=0 V.....	Switch selectable 0  or 1
Position indication.....	Mechanical
Running time for 90° .....	150 s
Sound power level.....	35 dB (A)
Protection class.....	III Safety extra-low voltage
Protection type .....	IP 54
Ambient temperature range .....	-30 to +50 °C
Ambient humidity .....	95 % RH

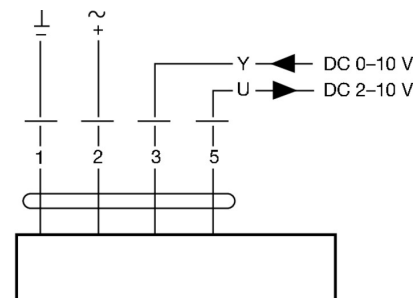

# Air stream operated dampers

## CARU, CAR

### Assembly

#### CARU

In order to fulfil the requirements of tightness class D the damper must be installed as per [‘Assembly Instruction Lindab Safe’](#).

#### CAR

The damper is installed by simply placing it inside a duct.

### Measurement

The dampers normally don't need any maintenance.

# Airflow meters

## FMU

### Assembly

In order to fulfil the requirements for air-tightness class D, the devices must be installed as per 'Assembly Instruction Lindab Safe'.

The devices allow 100 mm duct insulation without sticker or measuring points being hidden.

For optimum readability (regardless of the installation position), the plate with the sticker can be turned, folded up to prevent it disappearing in any insulation or to be easily removed and positioned separately from the device.

### Measurement

By measuring the pressure difference  $\Delta p$  in Pa at the measuring points, you can achieve a airflow  $q$  in l/s using the equation on the devices.

The specified airflows only apply for air with a density of 1.2 kg/m<sup>3</sup>. For air of another density ( $\rho_{\text{other}}$ ) the airflow ( $q_{\text{other\_density}}$ ) is achieved as per the formula:

$$q_{\text{other\_density}} = q_{\text{equation}} \times \sqrt{\frac{1,2}{\rho_{\text{other}}}}$$

Dimension mm	k-factor
80–63	4,40
100–80	7,32
125–100	11,2
160–125	18,0
200–160	29,4
250–200	45,7
315–250	73,3
400–315	116
500–400	191
630–500	283

### Systematic error

Straight stretches are required in order to achieve airflows as per equations with specified accuracy. The systematic error  $m_2$  is 5% and 10% below the minimum requirements for straight stretches as specified. For these minimum straight requirements – do not install measuring points in line with the nearest bend's inside radius.

### Maintenance

The devices normally don't require any maintenance.

### Cleaning

FMU does not limit cleaning opportunities.

# Damper with airflow meter

## EKOSI

### Assembly

Mount the dampers according to “Assembly Instructions Lindab Safe” to meet with the requirements for tightness ATC3 (C).

Consider required straight distance after or before disturbance, as mentioned on the card attached to the measurement nozzles, to obtain accurate airflow measurement.

The damper may not be loaded with weight from connected ducts, specially when assembled vertically.





### Measurement accuracy

If the velocity profile is asymmetric, the measurement values can differ from the ideal values. For this reason, the air airflow meter should never be located right up to any airflow disturbance.

The method error in the table will differ, depending on the distance to the air airflow disturbance.

If the damper is installed under ideal conditions, a maximum air airflow deviation of  $\pm 5\%$  can be expected.

The damper complies with airtightness ATC3 (C) in accordance with EN 1751.

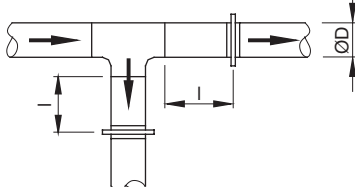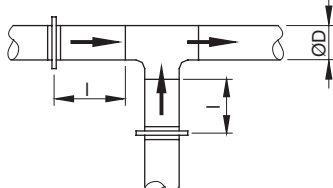
l = straight distance before and after disturbances	Method error $\pm 5\%$
	$l \geq 1 \text{ } \varnothing D$
	$l \geq 2 \text{ } \varnothing D$
	$l \geq 2 \text{ } \varnothing D$
	$l \geq 2 \text{ } \varnothing D$

# Damper with airflow meter

## EKOSI

### Balancing

- Connect the measuring hoses to the damper measuring nozzles.
- Adjust the desired restriction using a ring spanner or a screwdriver. Note the k-factor.
- Read the differential pressure  $\Delta p_m$
- Use a graph or the formula  $q = k \cdot \sqrt{\Delta p_m}$  to calculate the air airflow.
- Disconnect the hoses and plug the nozzles.

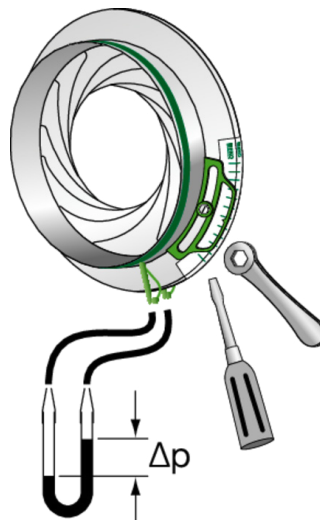

### Maintenance

The product normally doesn't require any maintenance.

### Cleaning

*By fully open the damper, one get access to the duct.*


When cleaning the duct, make a note of the damper's position before it opens fully. Reset the damper setting afterwards.

# Damper with airflow meter

## EKOSI

### Pressure loss graphs with noise generation for dimensioning

The dimensioning graphs show the pressure loss over the damper with airflow meter,  $\Delta p_t$ . They should be used to determine the pressure loss and to provide information about sound power levels at different settings.

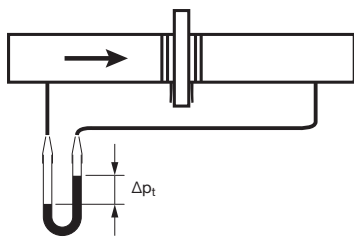

### Airflow graphs for balancing

The balancing graphs show the airflow as a function of the measured pressure,  $\Delta p_m$ . These graphs should be used to balance the system.






The balancing graphs show the airflow,  $q$ , as a function of the measured pressure,  $\Delta p_m$ , in the measure nozzles.

$$q = k \cdot \sqrt{\Delta p_m} \text{ (l/s)}$$

The formula is only accurate for air with the density 1,2 kg/m<sup>3</sup>. For air with other density, ( $\rho_{\text{other}}$ ), the airflow, ( $q_{\text{other}}$ ), is given according to the formula.

$$q_{\text{other}} = q_{\text{equation}} \times \sqrt{\frac{1,2}{\rho_{\text{other}}}}$$

k-factors can be found on the product label or in the Lindab calculation app, Vent Tools.


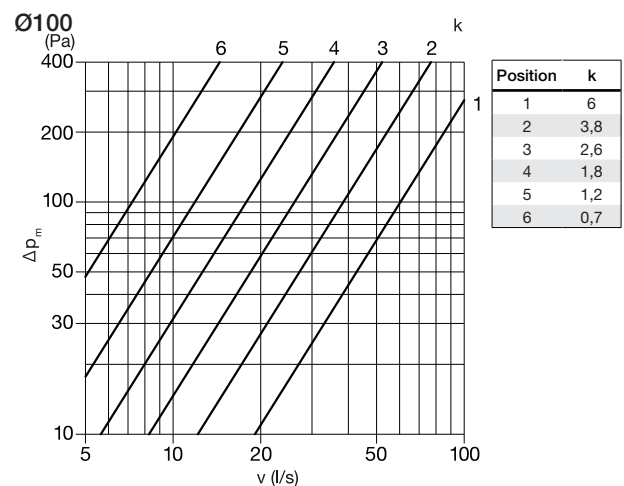
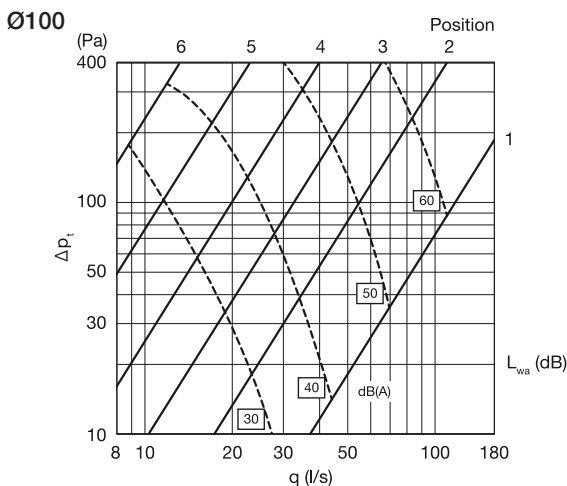
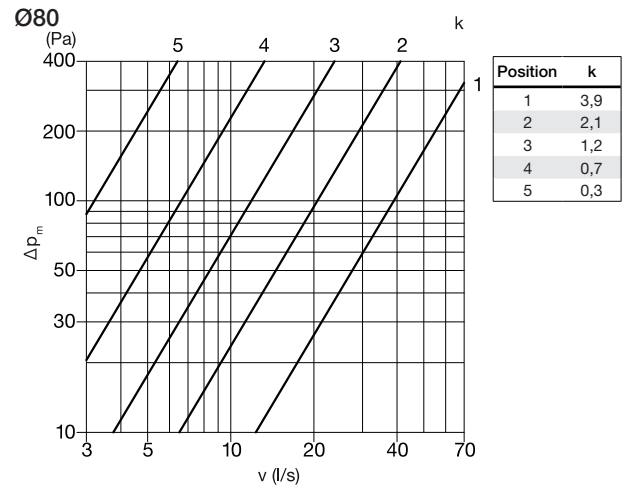
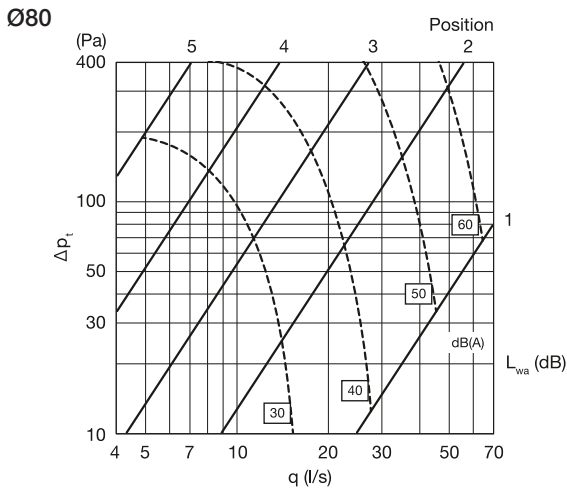



# Damper with airflow meter

## EKOSI

Pressure loss graphs with noise generation for dimensioning

Airflow graphs for balancing

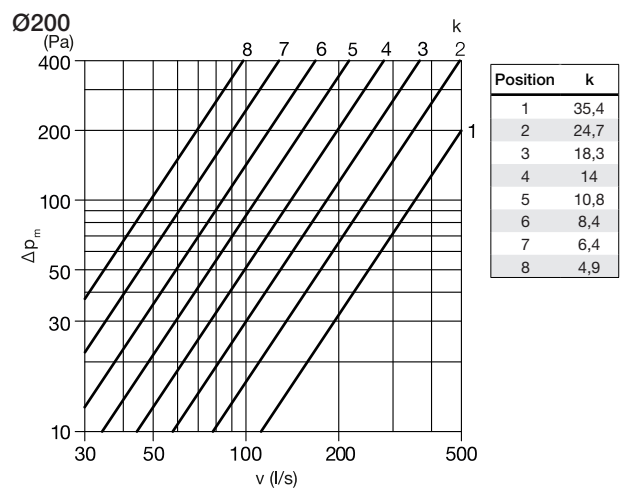
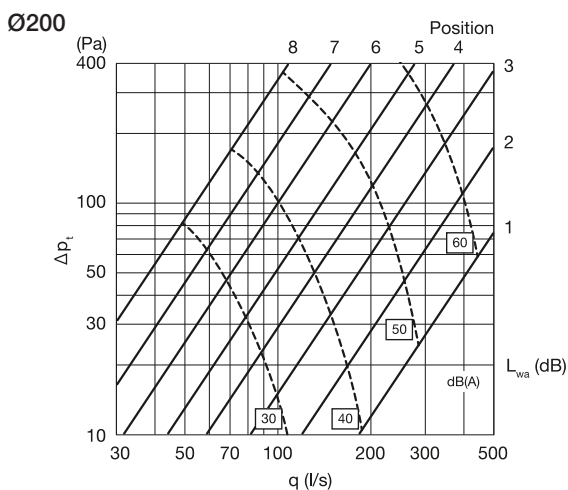
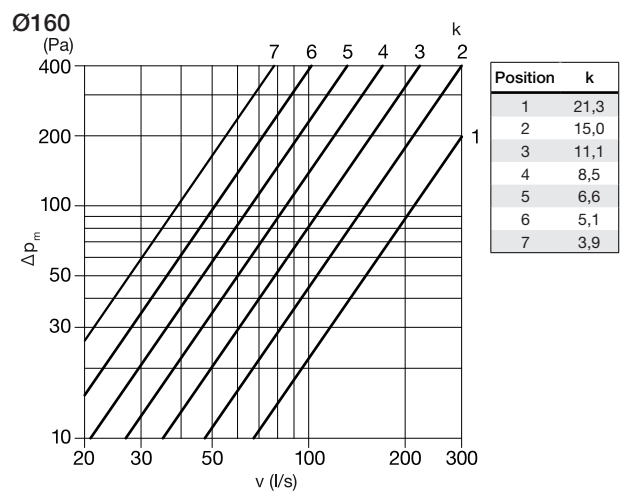
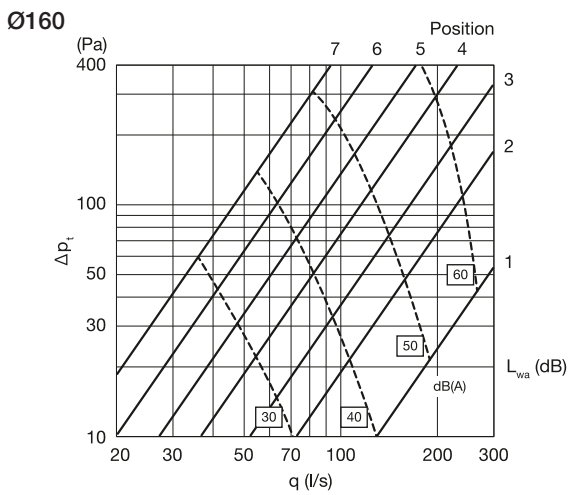
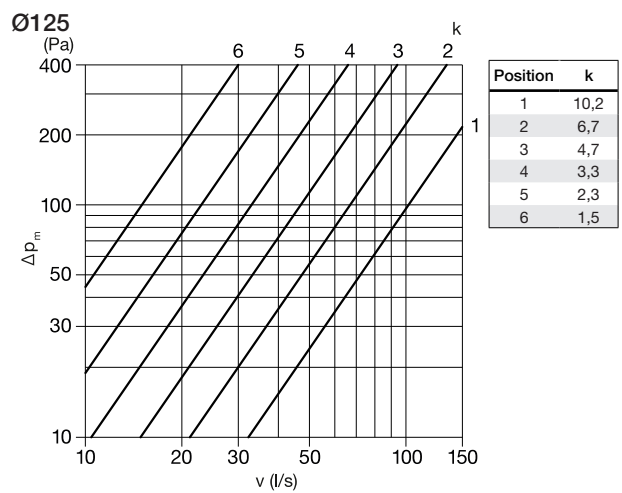
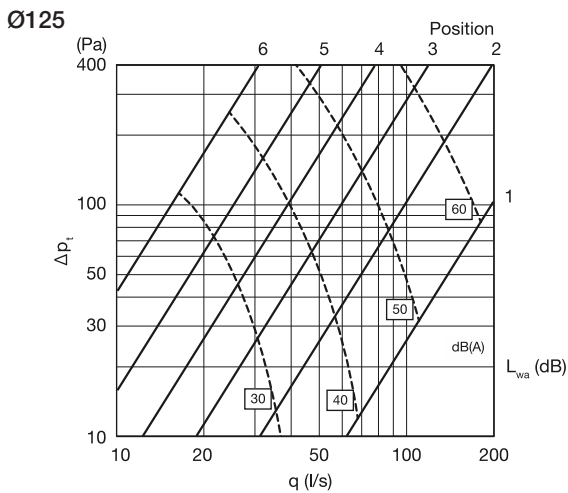


# Damper with airflow meter

## EKOSI

Pressure loss graphs with noise generation for dimensioning

Airflow graphs for balancing

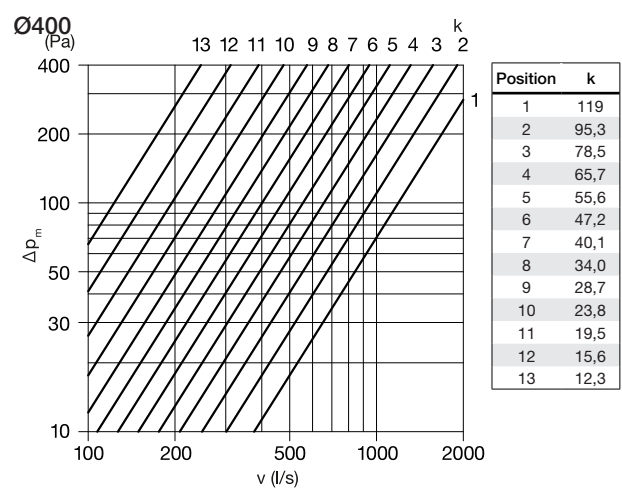
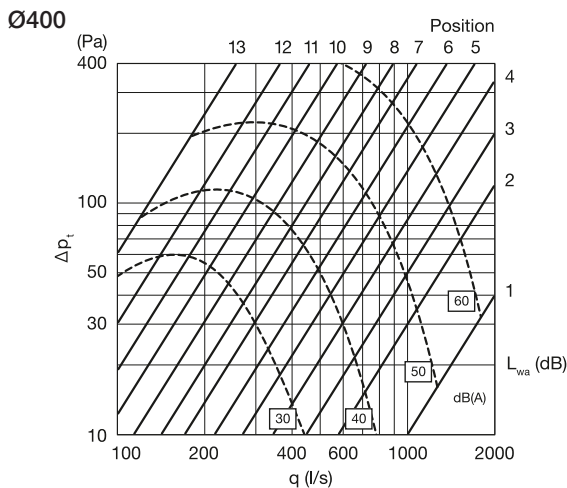
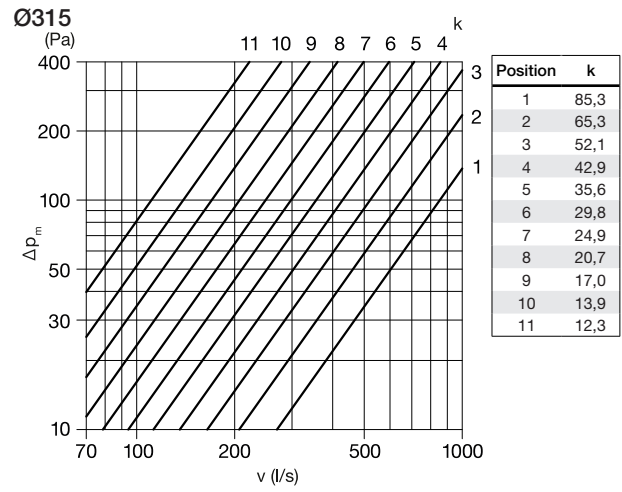
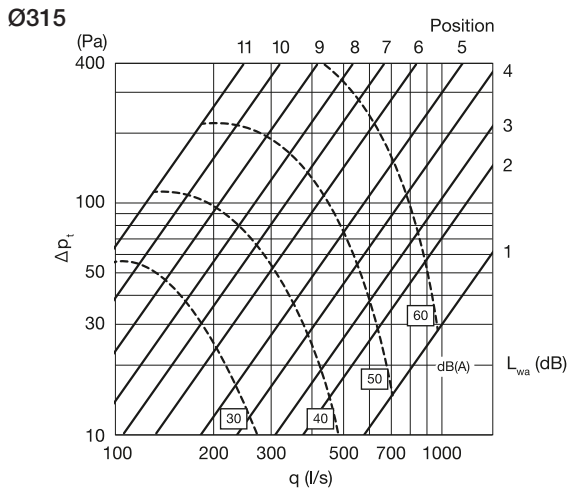
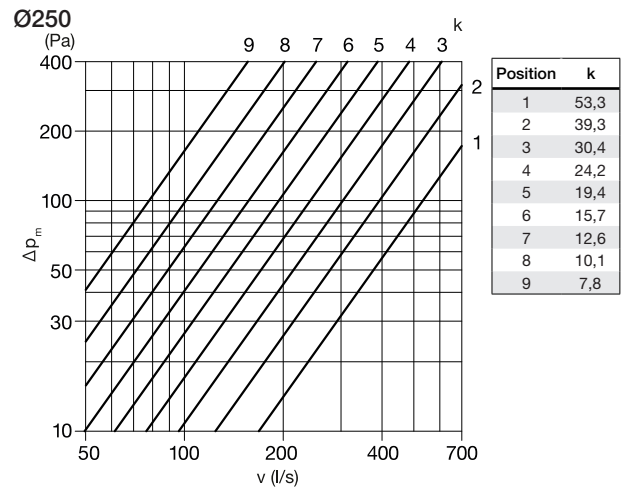
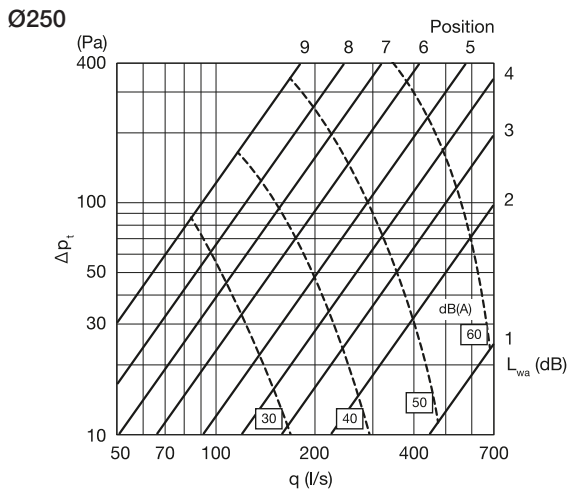


# Damper with airflow meter

## EKOSI

Pressure loss graphs with noise generation for dimensioning

Airflow graphs for balancing

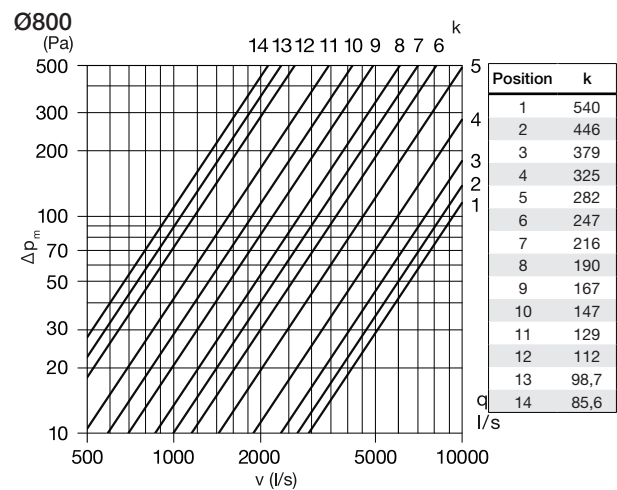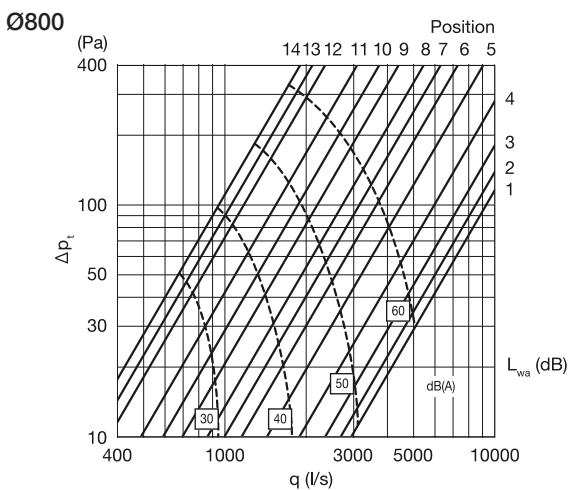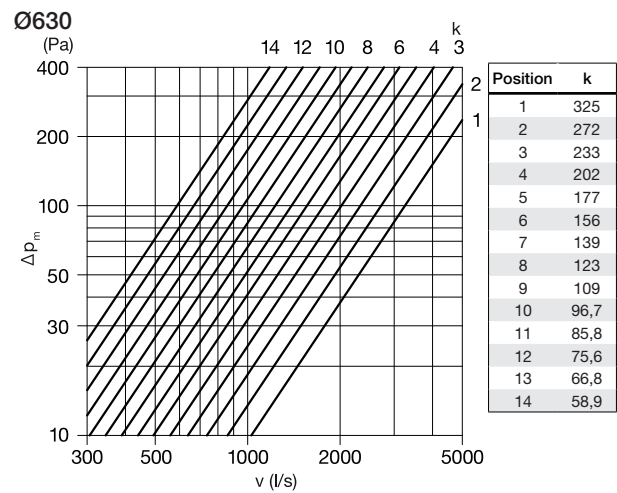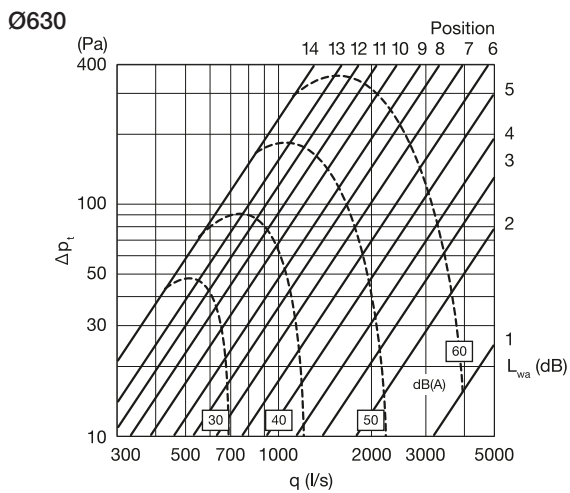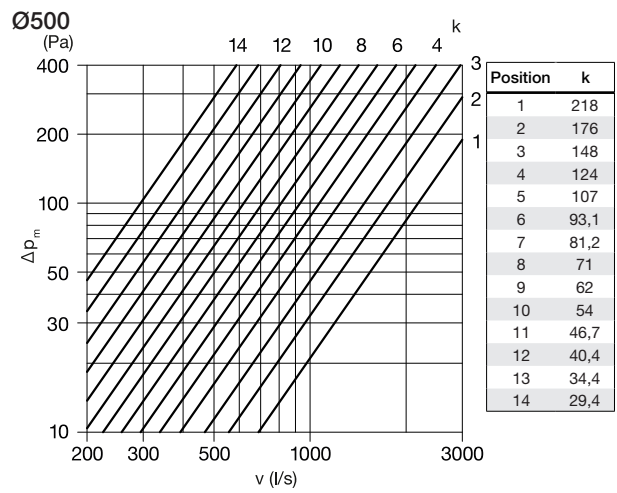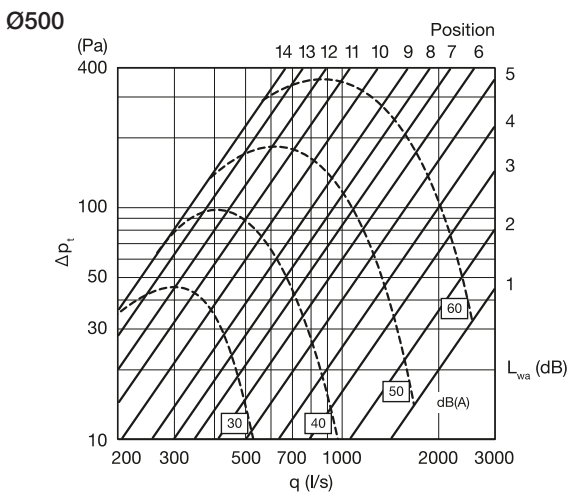

# UltraLink®

## Lindab UltraLink® Controller FTCU

Mounting instruction



Technical information



## Lindab UltraLink® Monitor FTMU

Mounting instruction



Technical information





Most of us spend the majority of our time indoors. Indoor climate is crucial to how we feel, how productive we are and if we stay healthy.

We at Lindab have therefore made it our most important objective to contribute to an indoor climate that improves people's lives. We do this by developing energy-efficient ventilation solutions and durable building products. We also aim to contribute to a better climate for our planet by working in a way that is sustainable for both people and the environment.

[Lindab | For a better climate](#)